
CITY OF BANNING ELECTRIC UTILITY

THIS STANDARD SHOWS THE REQUIREMENTS FOR AN 8' x 14' x 9'-6" PRECAST CONCRETE MANHOLE.

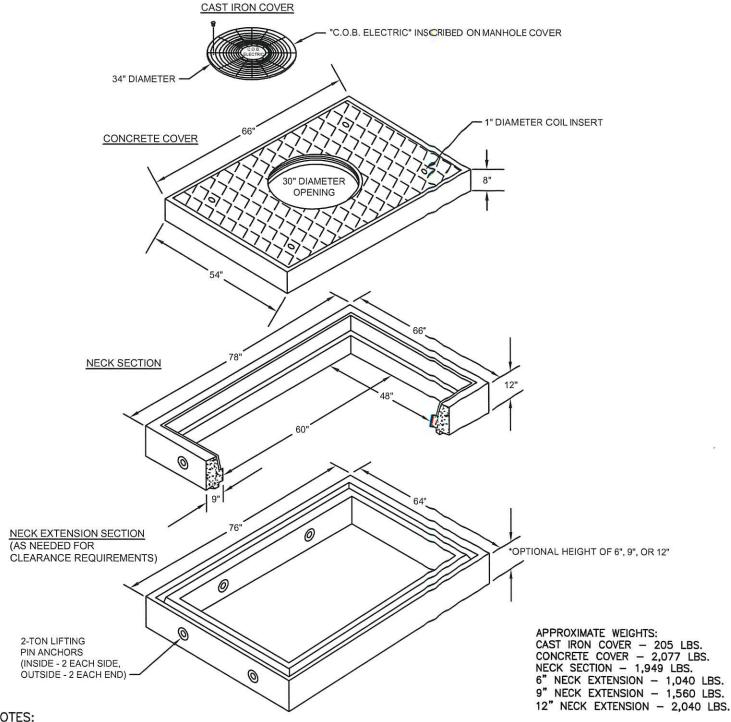

NOTES:

- PLACE PLASTIC-MASTIC SEALANT BETWEEN ALL SECTIONS. DO NOT APPLY SEALANT UNDER THE TOP SECTION IF CONCRETE IS REQUIRED FOR GRADE ADJUSTMENT.
- ALIGN MANHOLE COVER TO FINAL GRADE USING BRICKS. CONFIRM CONCRETE REQUIREMENTS WITH CITY OF BANNING PUBLIC WORKS INSPECTOR BEFORE ENCASING EXTERIOR OF MANHOLE NECKING. GROUT INTERIOR EDGES OF EACH PRECAST SECTION AND PAINT WHITE TO MATCH INTERIOR WALLS OF STRUCTURE.
- APPLY INHIBITOR TO THE BOLTS WHEN SECURING MANHOLE COVER TO REDUCE INSTALLATION OR REMOVAL DIFFICULTIES.
- PROVIDE UNOBSTRUCTED SPACE CLEARANCES AROUND VAULT PER SD #600-72.

REF: 3332.1



REVISED: 08/13/2019

APPROVED:

STANDARD DRAWINGS

PRECAST CONCRETE MANHOLE NECK, 8' x 14' x 9'-6"

600 - 58